

Formed Steel Louver

SL31

6" Deep • 35° Drainable Blade • Formed Steel Stationary Louver

STANDARD CONSTRUCTION

- FRAME:** 18-GA galvanized steel channel type
- BLADES:** 18-GA galvanized steel
- ASSEMBLY:** Riveted and/or welded for maximum service; Full sill with blades and head contained within
- FINISH:** Mill
- SCREEN:** ½" sq. mesh 19-GA galvanized

OPTIONS






- Flange Frame
- Extended Sub-Sills (3" or 5")
- Sub-Frame
- Installation Angles
- Stainless Steel, Other Steel Gauges
- Finishes - Baked Enamel, Epoxies
- Variety of Bird and Insect Screens
- Blank-Off Panels

NOTES

1. "A" width and "B" height are opening dimensions. Louvers are provided approximately ½" undersize.
2. Approximate louver weight is 8 lbs./sq.ft.

LOUVER SIZE



Panels	Minimum Panel	Maximum Panel
SL31	12"W x 12"H	60"W x 96"H

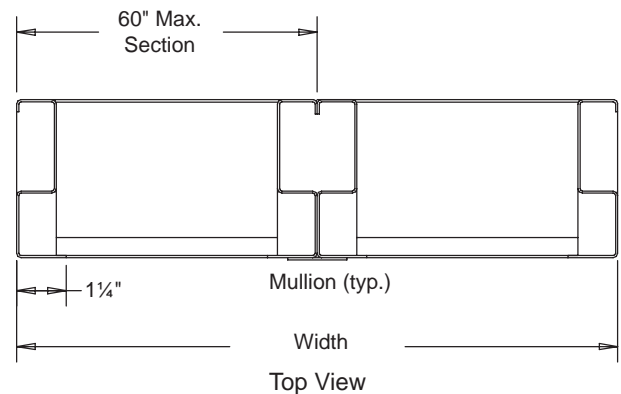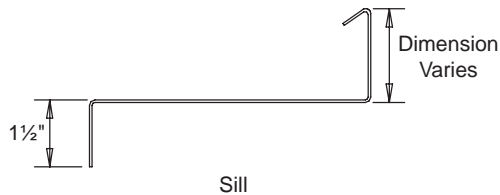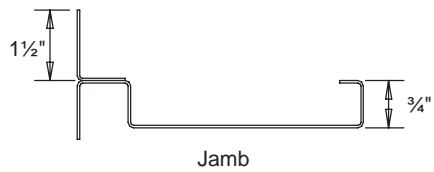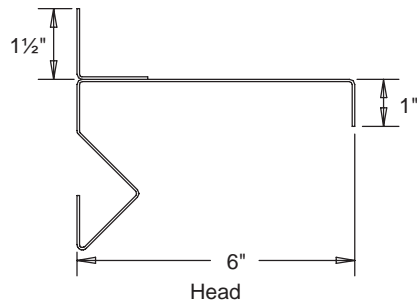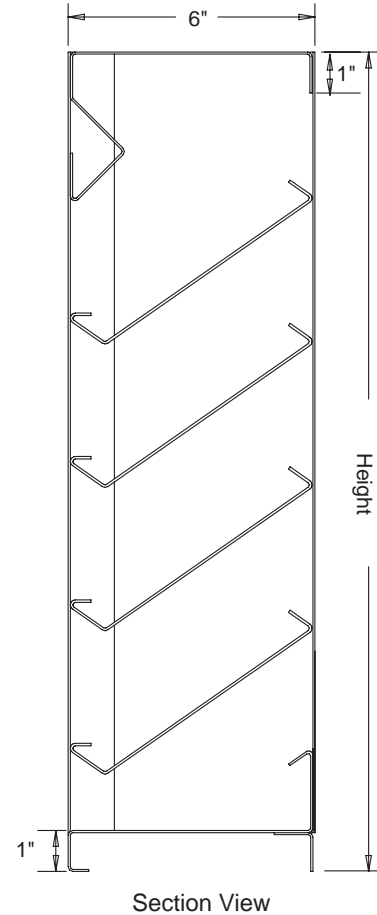

Water Penetration: 1200 fpm maximum recommended free area velocity
Pressure Drop: .14 in.wg at 1250 fpm and 11050 SCFM
Free Area: 8.84 sq.ft. = 55% for 48"W x 48"H test size

Performance Data

Tests of a 48"W x 48"H sample by an AMCA Registered Laboratory according to AMCA Standard 500 shows water penetration to be less than .02 oz/sq.ft. water penetration at 1250 fpm (Free Area Velocity) with less than .13 in.wg pressure drop at 950 fpm (intake). Ratings do not include effects of birdscreen.

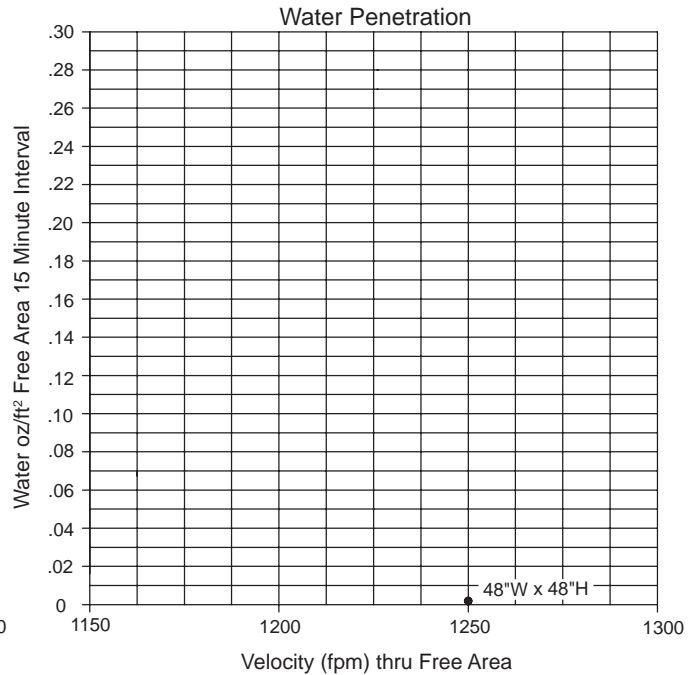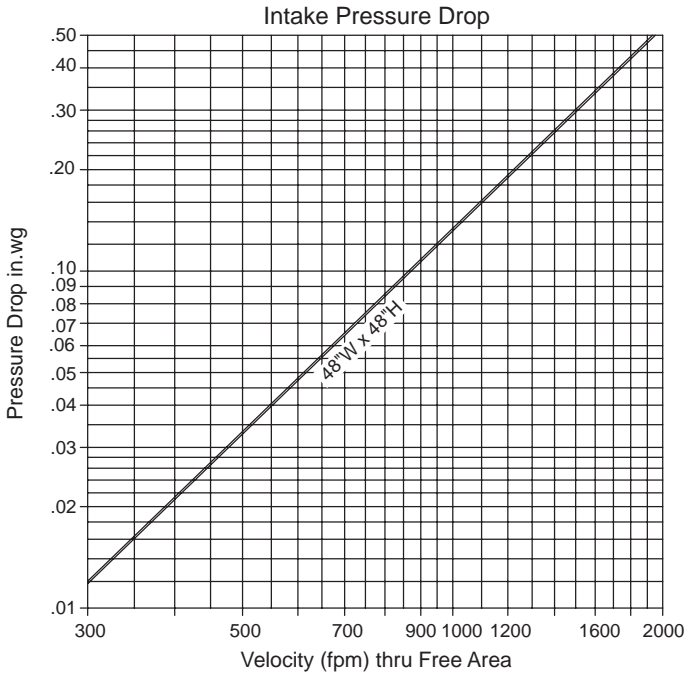

The beginning point of water penetration is above 1250 fpm through the free area of the louver.

Free Area sq.ft.

		Width								
		12	18	24	30	36	42	48	54	60
Height	12	.33	.52	.72	.91	1.11	1.31	1.50	1.70	1.89
	24	.82	1.32	1.81	2.31	2.80	3.30	3.79	4.29	4.78
	36	1.30	2.08	2.86	3.64	4.42	5.20	5.98	6.76	7.54
	48	1.89	3.02	4.15	5.28	6.41	7.54	8.84	9.81	10.94
	60	2.32	3.70	5.09	6.48	7.87	9.26	10.65	12.04	13.43
	72	2.89	4.63	6.37	8.10	9.84	11.58	13.32	15.05	16.79
	84	3.39	5.42	7.45	9.48	11.52	13.55	15.58	17.61	19.64
	96	3.90	6.24	8.59	10.93	13.27	15.61	17.95	20.30	22.64



L&D certifies that the model SL31 louvers shown herein is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The Certified Ratings Seal applies to Air Performance and Water Penetration Ratings.