

OpenAir™ GJD Series Electronic Damper Actuator

**UL Listed Fire/Smoke and Smoke Control
 Dampers 2-Position, 30-second Run Time,
 15-second Spring Return Time**



Description The OpenAir direct coupled, fast-acting, two-position, spring return electronic actuators are available as 24 Vac/dc, 120 Vac, and 230 Vac models. They are intended for use on UL-listed smoke control dampers and combination fire/smoke rated dampers.

- Features**
- (Optional) Built-in auxiliary switches: Fixed switch points at 5° and 85° rotation.
 - Electronic Fusible Link (EFL) capability with three temperature ratings: 165°F (74°C), 212°F (100°C), and 250°F (121°C).
 - Reversible fail-safe spring return.
 - Plenum-rated plastic housing.
 - Pre-cabled lead wires.
 - 30-second drive/15-second return operation at rated torque, temperature and voltage.

Application This actuator is used for the control of dampers requiring up to 20 lb-in (2 Nm) driving torque. It is intended for control of UL-listed smoke control dampers and combination fire/smoke HVAC dampers. This actuator is designed to meet the 2002 revisions to the UL 555/555S and the AMCA Standard 520 specifications.

Product Numbers

Product Number*	Torque		Voltage			Control Signal	EFL Capability	3-ft Plenum Cable	Auxiliary Switch
	20 lb-in (2 Nm)	24 Vac/dc	120 Vac	230 Vac	2-Position				
GJD121.1U	-	-	-	-	-	-	-	-	-
GJD126.1U	-	-	-	-	-	-	-	-	-
GJD221.1U	-	-	-	-	-	-	-	-	-
GJD226.1U	-	-	-	-	-	-	-	-	-
GJD321.1U	-	-	-	-	-	-	-	-	-
GJD326.1U	-	-	-	-	-	-	-	-	-

Warning/Caution Notations

WARNING		Personal injury or loss of life may occur if you do not perform a procedure as specified.
CAUTION:		Equipment damage may occur if you do not perform a procedure as specified.

Service



WARNING:

Do not open the actuator. Personal injury may occur if opened. Opening the actuator voids the warranty.

If the actuator is inoperative, replace the unit.

Specifications

Power supply	Operating voltage	24 Vac \pm 20% 24 Vdc +20%, -10%
	Frequency	50/60 Hz
	Frequency	120 Vac \pm 10%
	Frequency	60 Hz
	Frequency	230 Vac \pm 10%
	Frequency	50/60 Hz
	Power consumption	24 Vac/dc, 120 Vac
	Running	~ 10 VA/5W
	Holding	~ 5 VA/3W
	Power Consumption	230 Vac
	Running	~ 12 VA/5W
	Holding	~ 7 VA/3W



CAUTION:

Continuous use at voltages above the recommended tolerances may damage the actuator.

Function

Running torque	20 lb-in (2 Nm) (minimum)
Stall torque (minimum)	35 lb-in (4 Nm)
Torque reduction at elevated temperature	Less than 10%
Runtime for 90° closing (on power loss) with spring return	30 seconds nominal 15 seconds maximum
Nominal angle of rotation	95°

Life Expectancy

Minimum 20,000 full stroke cycles

Mounting

Damper shaft size	0.5-inch (12,7 mm) round
Damper shaft length, minimum	1.4-inch (36 mm)

Housing

Enclosure	NEMA 1
Material	Plenum-rated plastic


Ambient conditions

Operation	0°F to 130°F (–18°C to 55°C), one time 250°F (121°C) ½ hour per UL555S
Storage and transport	–40°F to 158°F (–40°C to 70°C)
Ambient humidity (non-condensing)	Maximum 95% rh non-condensing
Teflon® cable	400°F (200°C)

Specifications, Continued

Fixed Dual End Switches	Fixed Dual End Switches AC rating	24 Vac to 250 Vac, 24 Vdc 6A resistive/ 2 FLA/12 LRA
	Temperature rating	350°F (177°C)
Agency certification		UL60730 cUL CSA 60730 CE conformity for Residential, Commercial, and Industrial environments Australian RCM conformity
Miscellaneous	Pre-cabled connection Length:	3 ft (0.9m) 19/30 strand 18 GA
	Dimensions	5.61" H x 2.83" W x 2.48" D (142.6 mm H x 72 mm W x 63 mm D)
	Weight	1.32 lbs. (0.60 kg)
	Country of Origin	USA

Accessories



Electronic Fusible Link (EFL)

ASK791.165 (165°F [74°C] operation)
 ASK791.212 (212°F [100°C] operation)
 ASK791.250 (250°F [121°C] operation)

Figure 1.

Operation

When power is applied, the actuator coupling moves toward the open position, 90°. The actuator opens in 30 seconds nominal, 90° at 60 Hz. In the event of a power failure or when operating voltage is turned off, the actuator returns to the 0 position. The return time is 15 seconds (maximum) for 90°.

The National Fire Protection Association NFPA 92A Standard for Recommended Practice for Smoke-Control System and UL 864 Standard for Control Units and Accessories for Fire Alarm Systems, require weekly self-tests for **dedicated** smoke control equipment used in a smoke control system. The National Fire Protection Association NFPA 72 Standard for National Fire Alarm Codes states that all life-safety systems are to be functionally checked at least annually.

The GJD actuator does not require any periodic cycling to function properly as an integral part of an active smoke control damper system. Check the smoke control damper/actuator every time you functionally check your smoke detectors, emergency lights, and/or power generators for operation.

Installation

See *OpenAir™ GJD Series Electronic Damper Actuator Designed for UL Listed Fire/Smoke and Smoke Control Dampers Installation Instructions (A6V11275436)* for detailed guidelines.



CAUTION:


Read and carefully follow the Installation Instructions to avoid equipment damage.

Wiring

All wiring must conform to NEC and local codes and regulations.

Wire Designations


24 Vac/dc



Function	Color
Supply	Red
Neutral	Black

Figure 2.


120 Vac



Function	Color
Line	Black
Neutral	White

Figure 3.


230 Vac



Function	Color
Line	Brown
Neutral	Blue

Figure 4.

Auxiliary Switches

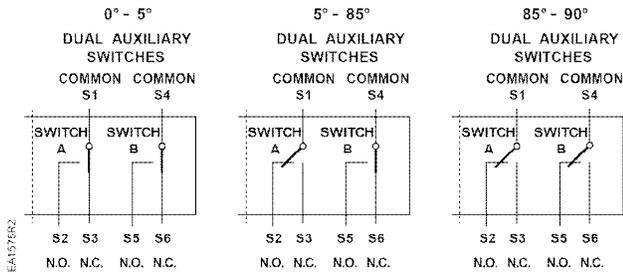

Actuator Position	Switch A Common S1 Connected to	Switch B Common S4 Connected to
0° to 5°	S3	S6
5° to 85°	S2	S6
85° to 90°	S2	S5



CAUTION:

Mixed switch operation to the switching outputs of both dual end switches (5° and 85°) is not permitted.

Either AC line voltage from the same phase must be applied to all six outputs of the fixed dual end switches, or UL-Class 2 voltage must be applied to all six outputs.

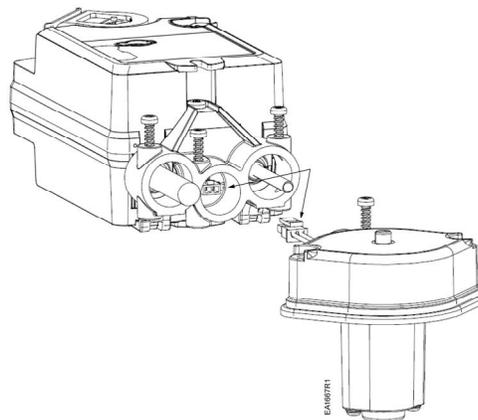


Figure 5. GJD Actuator and EFL.

NOTE:

GJD Damper Actuators are pre-wired for coupling with an EFL sensor.

Dimensions

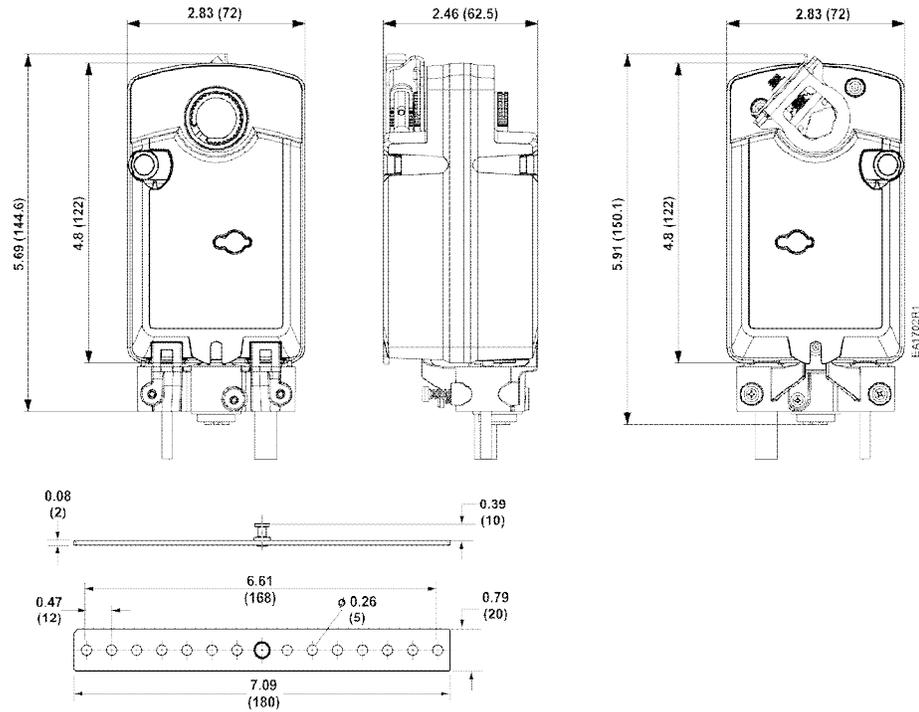


Figure 6. Dimensions of OpenAir GJD Actuator in Inches (Millimeters).

Information in this publication is based on current specifications. The company reserves the right to make changes in specifications and models as design improvements are introduced. OpenAir is a trademark of Siemens Schweiz AG. Product or company names mentioned herein may be the trademarks of their respective owners. © 2018 Siemens Industry, Inc.